

STREETBOND® SB150 COATED CONCRETE SURFACE SPECIFICATION

PART 1 – GENERAL

1.1 DESCRIPTION

- A. **StreetBond®** Advanced Coatings are specifically formulated for application to asphalt pavement but also excel over concrete when a primer is used. StreetBond® have been confirmed by a certified testing facility to possess a balance of performance properties for a durable and color-fast finish.
- B. A variety of **StreetBond®** coating colors are available. Please refer to hubss.com to view these. Custom colors are available upon request.
- C. Certain colors of the **StreetBond®** coatings have been independently verified to have an SRI greater than 29 and therefore can help projects qualify for points in the LEED® program under Heat Island Effect: Non-Roof. Please refer to hubss.com for further information.
- D. **StreetBond® WB Concrete Primer** is the only concrete primer specified for use with **StreetBond®** coatings.
- E. Qualifications. Only **Accredited StreetBond® Applicators** may bid for and perform the imprinted portion of this work. Please refer to **Section 1.3 DEFINITIONS**.
- F. **StreetBond®** products are manufactured in **ISO 9001:2008 / ISO 14001:2004** facilities to ensure quality products produced in legally-responsible and environmentally-conscious manner.
- G. **StreetBond®** coatings are only available from GAF.

1.2 REFERENCES

- A. **ASTM D4541** Standard Test Method for Pull-Off Strength of Coatings Using Portable Adhesion Tester.
- B. **ASTM D4060** Test Method for Abrasion Resistance of Organic Coatings by the Taber Abraser.
- C. **ASTM D2697** Standard Test Method for Volume of Nonvolatile Matter in Clear or Pigmented Coatings.
- D. **ASTM D522-93A** Standard Test Method for Mandrel Bend Test of Attached Organic Coatings.
- E. **ASTM D1653** Standard Test Method for water vapor transmission through organic film coatings.
- F. **ASTM G154 QUV** Accelerated Weathering Environment. Standard Practice for Operating Fluorescent Light Apparatus for UV Exposure of Nonmetallic Materials.
- G. **ASTM D2369** Weight Solids Standard test method for Volatile Content of Coatings.
- H. **ASTM D1475** Standard Test method for Density of Paint, Varnish, Lacquer, Other related products.
- I. **ASTM D2240 (2000)** Standard Test Method for Rubber property – Durometer hardness.
- J. **ASTM D5895** Standard Test Method of drying or curing during film formation of organic coatings using mechanical recorders.
- K. **ASTM D570** Standard Test Method for water absorption of plastics.

STREETBOND® SB150 COATED CONCRETE SURFACE SPECIFICATION

1.3 DEFINITIONS

- A. **“Accredited StreetBond® Applicator”** has valid Certification for both Textured (stamped) and Non-Textured (flatwork) as offered by GAF and are reviewed on an annual basis. All **Accredited StreetBond® Applicators** have been qualified by GAF to perform the Work and offer a product Warranty.
- B. **“Approved Applicator”** has valid Certification for non-textured (flatwork) application **ONLY** as offered by GAF and are reviewed on an annual basis. Product Warranties may be available to **Approved Applicators** but require approval and supervision by a GAF Technical Sales Representative.
- C. **“Applicator”** means the installer of the **StreetBond®** coatings.
- D. **“Owner”** means the Owner and refers to the representative person who has decision making authority for the Work.
- E. **“TSR”** is a GAF Technical Sales Representative who manages the StreetBond® product in a given territory.
- F. **“Concrete pavement”** is concrete pavement to which coating will be applied and once the surface has been properly repaired.
- G. **The “Work”** is the concrete pavement coating work contemplated in this bid submission and specification.
- H. **“Layer”** is a signal thin pass of coating, applied with a texture spray gun, which is allowed to dry before the next layer is applied.
- I. **“Warranty”** is a guarantee to the property owner that StreetBond® SB150, when properly applied, will not peel, delaminate or show abnormal wear over specific period of time depending on the traffic volumes and number of layers applied. Please contact your local TSR for more details.

1.4 SUBMITTALS

A copy of the Accreditation Certificate, available from the **Applicator**, is required with submittal. Independent product test results available upon request.

STREETBOND® SB150 COATED CONCRETE SURFACE SPECIFICATION

PART 2 – PRODUCTS

2.1 MATERIALS – STREETBOND® COATINGS

StreetBond® coatings have been scientifically formulated to provide the optimal balance of performance properties for a durable, long-lasting color and textured finish to any pavement surfaces. Some of these key properties include wear and crack resistance, color retention, adhesion, minimal water absorption and increased friction properties. **StreetBond®** coatings are environmentally safe and meet EPA requirements for Volatile Organic Compounds (VOC).

- A. **StreetBond® SB150** is a two-part premium epoxy-modified, acrylic, waterborne coating specifically designed for application on asphalt pavements but also excel over concrete when a primer is used. It has a balance of properties to ensure good adhesion and movement on flexible pavement, while providing good durability. **StreetBond® SB150** is durable in both dry and wet environments.
- B. **StreetBond® Colorant** is a highly concentrated, high quality, UV stable pigment blend designed to add color to **StreetBond® SB150** coatings. One unit of Colorant shall be used with one pail of **StreetBond®** coating material.
- C. **StreetBond® WB Concrete Primer** is a clear, single component epoxy primer specifically designed to increase the bond for StreetBond® coatings to concrete surfaces. StreetBond® WB Concrete Primer protects against destructive salts, oils, solvents and gasoline. Its low viscosity allows it to penetrate into the surface creating a tenacious physical and chemical bond.

2.1.1 Properties of StreetBond® coatings

The following tables outline the test results for physical and performance properties of the **StreetBond®** coatings as determined by an independent testing laboratory.

TABLE 1: Typical Physical Properties of StreetBond® Coatings

| Characteristic | Test Specification | SB150 |
|------------------|--------------------|---------------------------|
| Solids by Volume | ASTM D2697 | 59.14% |
| Solids by Weight | ASTM D2369 | 71.60% |
| Density | ASTM D1475 | 13.27 lbs/gal (1.59kg/l) |

STREETBOND® SB150 COATED CONCRETE SURFACE SPECIFICATION

TABLE 2: Typical Performance Properties of StreetBond® Coatings

| Characteristic | Test Specification | SB150 |
|---|--------------------------------------|-----------------------------------|
| Dry time (To re-coat) | ASTM D5895 23°C; 37% RH | 35 min |
| Taber Wear Abrasion Dry H-10 wheel | ASTM D4060 1 day cure | 0.33g/1000 cycles |
| Taber Wear Abrasion Wet H-10 wheel | ASTM D4060 7 days cure | 0.15g/1000 cycles |
| QUV Accelerate Weathering Environment | ASTM G151 ΔE 1,500hrs. | 0.53 (Brick) |
| Hydrophobicity Water Absorption | ASTM D570 | 7.89% |
| Shore hardness | ASTM D2240 | 80.8 |
| Mandrel Bend | ASTM D522-93A | 1/8" @ 23 C |
| Permeance | ASTM D1653 | 5.6 perm |
| VOC | per MSDS | 19.14% |
| Adhesion to concrete (with StreetBond® WB Concrete Primer) | ASTM D4541 | 463.33 psi (Substrate Failure) |
| Friction Wet | ASTM E303 British Pendulum Tester | Wet=77.3 Dry=81.3 |

Certificates of Analysis are available upon request for each of these properties.

2.2 EQUIPMENT FOR STREETBOND® APPLICATION

The equipment described has been designed specifically for optimal application of StreetBond® coatings. Other equipment may or may not be suitable and could compromise the performance of the StreetBond® coatings and/or reduce crew productivity.

- A. The **SB Flex Sprayer** is a proprietary coating sprayer supplied by Intech Equipment and is capable of applying the **StreetBond®** coatings to the prepared concrete surface in a thin, controlled film which will optimize the drying and curing time of the coating. A **Graco RTX** and **RapidSprayerII** sprayer may also be used.
- B. The **StreetBond® Coatings Mixer** is a motorized mixing device designed to ensure efficient and thorough blending of the **StreetBond®** components.
- C. **Backpack or Hand-Held low pressure sprayer** to apply the **StreetBond® WB Concrete Primer**.
- D. The **RapidFinisher II** is an electric powered broom produced by HUB Surface Systems that can be used in the application of **StreetBond®** coatings to improve productivity. It is especially useful on larger projects.

STREETBOND® SB150 COATED CONCRETE SURFACE SPECIFICATION

PART 3 – EXECUTION

3.1 GENERAL

StreetBond® coating shall be supplied and applied on concrete surface by an **Accredited StreetBond® Applicator** in accordance with the plans and specifications or as directed by the Owner. Do not begin installation without confirmation of an Accreditation Certificate. Specifications for the execution of the **StreetPrint®** system can be found at gaf.com.

3.2 PRE-CONDITIONS

The condition of the concrete substrate will impact the performance of the **StreetBond®** coatings. A highly stable concrete pavement free of defects is recommended.

3.2.1 Concrete Surface Preparation

- A. The concrete pavement surfaces must be clean and free of any dirt, oil, grease, soapy films, surface chemicals or other foreign contaminants. New concrete should be water-cured in lieu of using a curing compound. Any form of curing compound or release agent on any surface to be sealed with WB Concrete Primer must be completely removed, along with any laitance.
- B. If concrete is badly spalled, restore surface to a reasonable condition using cementitious patching or resurfacing compound. New concrete that has been previously cured with a curing compound, or concrete that has smooth trowelled, shall be cleaned and etched with 10% Muriatic Acid solution. Wash with a biodegradable cleaner and follow with a generous rinse of clean water.
- C. Existing stable concrete must be cleaned with a biodegradable chemical cleaner and water. Cleaning shall be accomplished using mechanical scrubbers. Rinse thoroughly with fresh water to remove all traces of the chemical cleaner. If general cleaning is not adequate, then surfaces should be cleaned and etched as recommended for new concrete.
- D. If surfaces are highly contaminated, or if surfaces are to be subjected to unusual service conditions, consult GAF's Technical Service Department for recommendations.

STREETBOND® SB150 COATED CONCRETE SURFACE SPECIFICATION

3.3 APPLICATION OF STREETBOND® COATINGS

3.3.1 Coating Application Guidelines

- A.** The **Applicator** shall use the **SB Flex Spray System** or suitable texture coatings sprayers to apply the **StreetBond®** coatings.
- B.** The concrete pavement surface shall be completely dry and thoroughly cleaned prior to application of the coatings.
- C.** **StreetBond® WB Concrete Primer** should be applied and allowed to cure prior to the first layers of coating. Please consult Technical Data sheets for more details on applications and mixing instructions.
- D.** The first layer of coating shall be spray applied then broomed to work the coating material into the pavement surface. Subsequent applications shall be sprayed then broomed or rolled. Each application of coating material shall be allowed to dry to the touch before applying the next layer.
- E.** The **Applicator** shall apply the **StreetBond®** coatings only when the air temperature is 50°F / (10°C) and rising and will not drop below 50°F / (10°C) within 24 hours. No precipitation should be expected within 24 hours.

3.4 COATING COVERAGE & THICKNESS

Coating coverage and thickness is as outlined in **TABLE 4** below. Actual coverage may be affected by the texture of the concrete pavement. There will be less coverage with the first layer and higher coverage with subsequent layers.

TABLE 4: Coating Coverage & Thickness

| # OF LAYERS | COVERAGE (approx.) | | THICKNESS (approx.) | | | |
|-------------|--------------------|-----------|---------------------|-----|------|-----|
| | NON-TEXTURED | | WET | | DRY | |
| | sqft/unit* | sqm/unit* | mm | mil | mm | mil |
| 3 | 200 | 18.6 | 0.84 | 33 | 0.48 | 19 |
| 4 | 150 | 13.9 | 1.12 | 44 | 0.66 | 26 |
| 5 | 120 | 11.2 | 1.40 | 55 | 0.81 | 32 |
| 6 | 100 | 9.3 | 1.68 | 66 | 0.97 | 38 |

**1 unit is a nominal 5 gallon pail comprising Part A, Part B and Colorant (approximately 4.12 gallons). 1 unit when sprayed as a single layer covers approximately 600sqft (55.7 sqm), with an approximate thickness of 6.3mil (0.16mm) dry. Smoother concrete surfaces will increase your coverage rate per unit.*

STREETBOND® SB150 COATED CONCRETE SURFACE SPECIFICATION

3.5 RECOMMENDED COATING COVERAGE RATES

Please check with GAF Products in advance to confirm the recommended application for the climate conditions at the project location.

TABLE 5: Recommended Coating Coverage Rates

| Application | Hot Dry Climate | Temperate/Winter Climate |
|---|--|--|
| Pedestrian only | 3 layers at 600 ft ² (56m ²) per 5 gallon (20 Litre) unit for a net coverage of 200 ft ² (18.6m ²) per 5 gallon (20 Litre) unit | 3 layers at 600 ft ² (56m ²) per 5 gallon (20 Litre) unit for a net coverage of 200 ft ² (18.6m ²) per 5 gallon (20 Litre) unit |
| Residential driveway | 3 layers at 600 ft ² (56m ²) per 5 gallon (20 Litre) unit for a net coverage of 200 ft ² (18.6m ²) per 5 gallon (20 Litre) unit | 3 layers at 600 ft ² (56m ²) per 5 gallon (20 Litre) unit for a net coverage of 200 ft ² (18.6m ²) per 5 gallon (20 Litre) unit |
| Vehicular traffic | | |
| Up to 500 cars per day per lane | 4 layers at 600 ft ² (56m ²) per 5 gallon (20 Litre) unit for a net coverage of 150 ft ² (13.9m ²) per 5 gallon (20 Litre) unit | 4 layers at 600 ft ² (56m ²) per 5 gallon (20 Litre) unit for a net coverage of 150 ft ² (13.9m ²) per 5 gallon (20 Litre) unit |
| 500 to 1000 cars per day per lane | 4 layers at 600 ft ² (56m ²) per 5 gallon (20 Litre) unit for a net coverage of 150 ft ² (13.9m ²) per 5 gallon (20 Litre) unit | 4 layers at 600 ft ² (56m ²) per 5 gallon (20 Litre) unit for a net coverage of 150 ft ² (13.9m ²) per 5 gallon (20 Litre) unit, plus one additional layer in the wheel paths |
| 1000 to 2000 cars per day per lane | 4 layers at 600 ft ² (56m ²) per 5 gallon (20 Litre) unit for a net coverage of 150 ft ² (13.9m ²) per 5 gallon (20 Litre) unit, plus one additional layer in the wheel paths | 4 layers at 600 ft ² (56m ²) per 5 gallon (20 Litre) unit for a net coverage of 150 ft ² (13.9m ²) per 5 gallon (20 Litre) unit, plus two additional layers in the wheel paths |
| 2000 to 3000 cars per day per lane | 4 passes at 600 ft ² (56m ²) per 5 gallon (20 Litre) unit for a net coverage of 150 ft ² (13.9m ²) per 5 gallon (20 Litre) unit, plus two additional layers in the wheel paths | No warranty is provided for traffic levels above 2000 cars per day per lane |
| | No warranty is provided for traffic levels above 3000 cars per day per lane | |


1. **Additional layers of StreetBond® SB150** coatings may be used to provide additional build thickness in high wear areas such as vehicle wheel paths and turning areas.
2. A maintenance program may be required for applications exposed to:
 - abrasive materials (such as salt and sand)
 - abrasive equipment (such as snow removal equipment)
 - Studded winter tires

STREETBOND® SB150 COATED CONCRETE SURFACE SPECIFICATION

3.6 OPENING TO TRAFFIC

Minimally, StreetBond® SB150 coating must be 100% dry and sufficient curing time must be allowed before traffic is permitted on the surface.

TABLE 6: COATING DRY TIMES (TYPICAL)

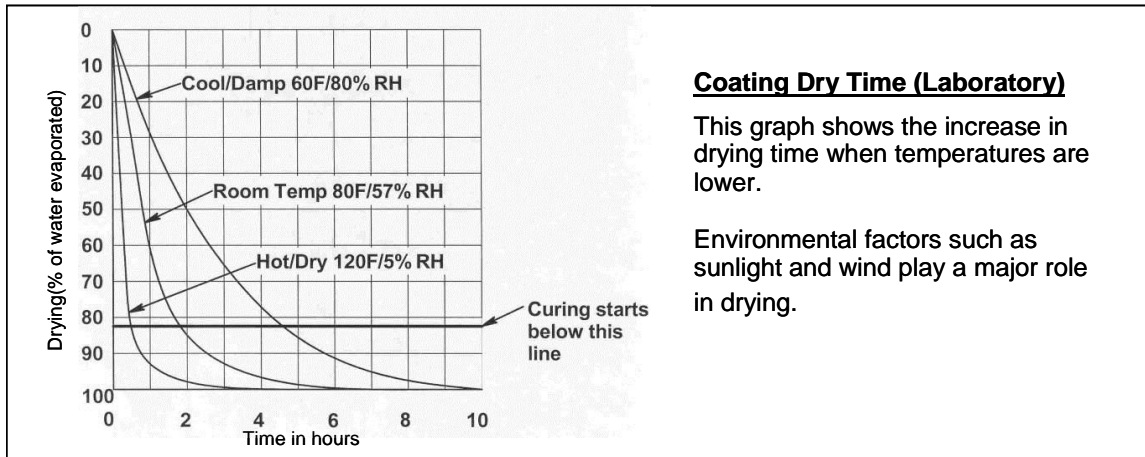

If StreetBond® coatings are applied when moisture cannot evaporate, then the coating will not dry. The drying and curing of StreetBond® coatings have a direct impact on performance.

PART 4 – MEASUREMENT AND PAYMENT

4.1 MEASUREMENT

The measured area is the actual area of concrete pavement where **StreetBond®** has been applied, measured in place. No deduction will be made for the area(s) occupied by manholes, inlets, drainage structures, bollards or by any public utility appurtenances within the area.

4.2 PAYMENT

Payment will be full compensation for all work completed as per conditions set out in the contract. For unit price contracts, the payment shall be calculated using the measured area as determined above.